


SPECIFICATION SHEET

SINGLE DUCT AIR TERMINAL - COOLING ONLY


ANALOG ELECTRONIC CONTROLS

ET - CONTROL OPTION

CARNES COMPANY 448 S. Main St., P. O. Box 930040, Verona, WI 53593-0040 Phone: (608)845-6411 Fax: (608)845-6504 www.carnes.com



ITEM	PART NO.	DESCRIPTION
1	999-2661	CSP-5001 CONTROLLER/ACTUATOR
2	AXWCA	CTE-5101 THERMOSTAT

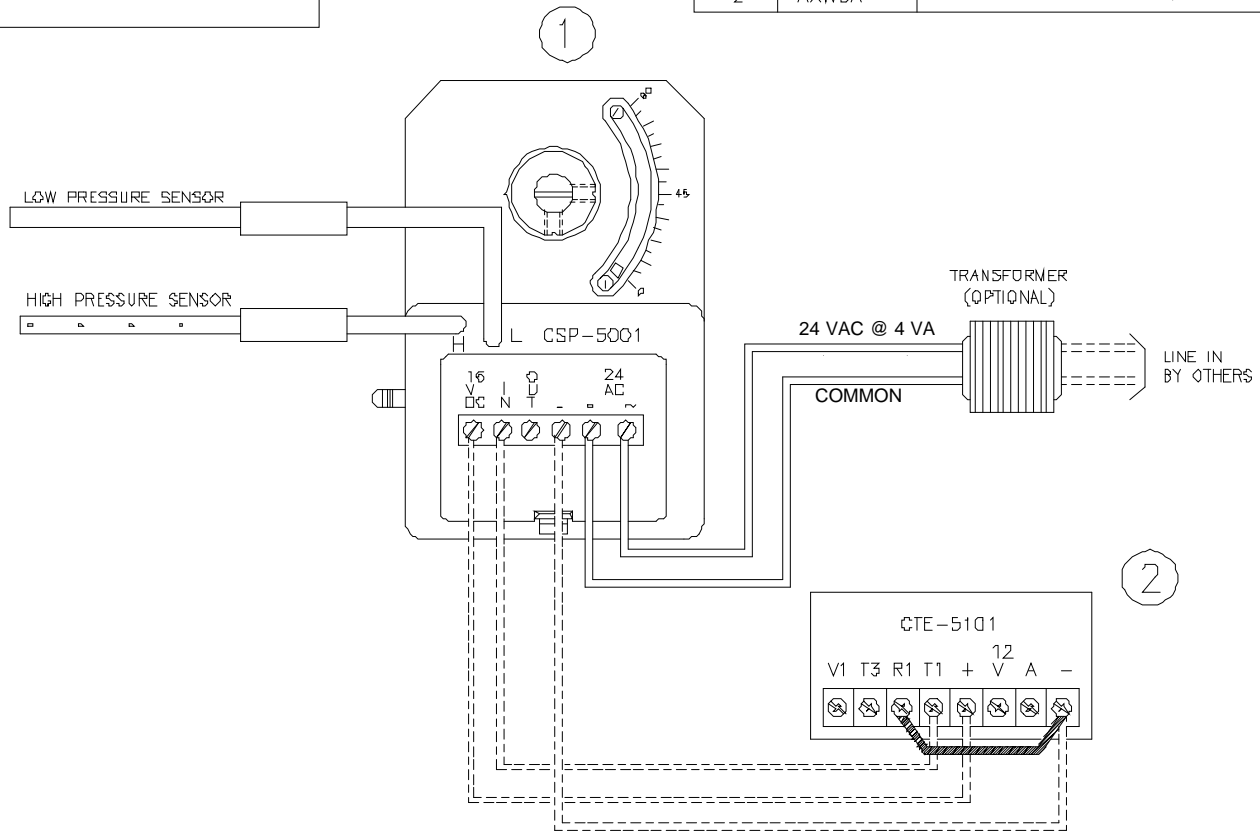

SEQUENCE OF OPERATION

ON A CALL FOR COOLING, AIRFLOW WILL INCREASE AS THE DAMPER OPENS TOWARDS THE MAXIMUM CFM SETTING TO SATISFY ROOM SET-POINT.

ON A CALL FOR LESS COOLING, AIRFLOW WILL DECREASE AS THE DAMPER CLOSES TOWARDS THE MINIMUM CFM SETTING TO SATISFY ROOM SET-POINT.

CONTROL DIAGRAM

