



# IN-LINE VENTILATORS





Page 1

# **READ AND SAVE THESE INSTRUCTIONS**

## WARNING





# TO REDUCE THE RISK OF FIRE, ELECTRIC SHOCK, OR INJURY TO PERSONS, OBSERVE THE FOLLOWING:

- Use this unit only in the manner intended by the manufacturer. If you have questions, contact the manufacturer at the address or telephone number listed in the warranty.
- Before servicing or cleaning unit, switch power off at service panel and lock the service disconnecting means to prevent power from being switched on accidentally. When the service disconnecting means cannot be locked, securely fasten a prominent warning device, such as a tag, to the service panel.
- Installation work and electrical wiring must be done by a qualified person(s) in accordance with all applicable codes and standards, including fire-rated construction codes and standards.
- 4. Sufficient air is needed for proper combustion and exhausting of gases through the flue (chimney) of fuel burning equipment to prevent backdrafting. Follow the heating equipment manufacturer's guideline and safety standards such as those published by the National Fire Protection Association (NFPA), and the American Society for Heating, Refrigeration and Air Conditioning Engineers (ASHRAE), and the local code authorities.
- When cutting or drilling into wall or ceiling, do not damage electrical wiring and other hidden utilities.
- 6. Ducted fans must always be vented to the outdoors.
- 7. To reduce the risk of fire, use only metal ductwork.
- If this unit is to be installed over a tub or shower, it must be marked as appropriate for the application and be connected to a GFCI (Ground Fault Interrupter) - protected branch circuit.
- Never place a switch where it can be reached from a tub or shower.
- 10. This unit must be grounded.

# **CAUTION**



- For general ventilating use only. Do not use to exhaust hazardous or explosive materials and vapors.
- To avoid motor bearing damage and noisy and/or unbalanced impellers, keep drywall spray, construction dust, etc. off power unit.
- Please read specification label on product for further information and requirements.

### TABLE OF CONTENTS

This manual is divided into sections as follows:

#### "TYPICAL INSTALLATION"

This section shows a common installation in new and existing, frame construction.


- Mounting (new construction)
- Mounting (existing construction)
- Wiring
- Ducting (straight through blower discharge)
- "MOUNTING OPTIONS"
- "WIRING OPTIONS"
  - -Wiring Plate Position
- "DUCTING OPTIONS"
  - Blower Discharge Positions
  - Ducting (right angle blower discharge)
- "USE AND CARE"
- "SERVICE PARTS"
- "WARRANTY"



Page 2


### TYPICAL INSTALLATION

#### MOUNTING (New Frame Construction)

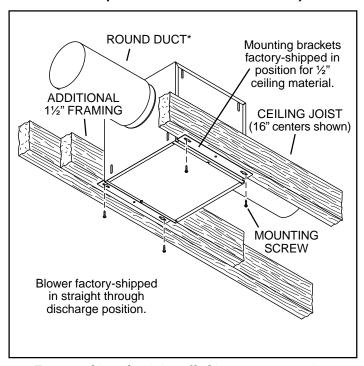

Factory-shipped unit installed in <u>new</u> construction.

### MOUNTING (Existing Frame Construction)

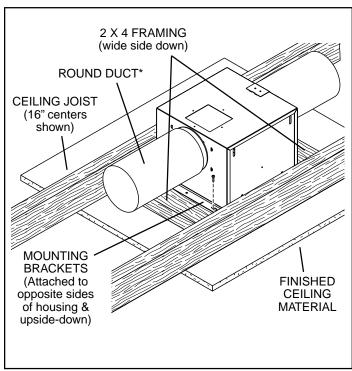


Factory-shipped unit installed in existing construction.

\* VCDD010I & VCDD015I use 6" round duct. VCDD020I, VCDD025I & VCDD030I use 8" round duct.


### **TYPICAL INSTALLATION**

#### **WIRING**

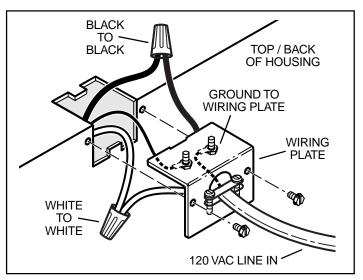

Ventilator can be wired from outside of housing. Use UL approved connectors to wire per local codes.

#### **DUCTING** (Horizontal blower discharge)

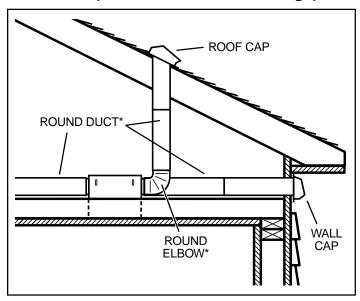

Two ways to connect ductwork to a factory-shipped unit.

\* VCDD010I & VCDD015I use 6" round duct. VCDD020I, VCDD025I & VCDD030I use 8" round duct.

#### **IMPORTANT:**

#### Remove shipping tape from damper

Remove the shipping tape from the damper flap and make sure that damper flap opens and closes freely inside the ductwork. Use duct tape to make ductwork connections secure and air-tight.

#### Remove shipping ring from blower inlet


Remove the shipping ring from the blower inlet <u>before</u> operating the ventilator.



Page 3

# **MOUNTING OPTIONS**

¼-20 hex nuts secure mounting brackets to housing. Loosen and re-tighten or remove and replace nuts as necessary for desired mounting bracket position.




Mounting brackets in factory-shipped position.
(Outlet parallel to joists.)
(New construction)


Mounting brackets flipped over and mounted to outlet sides of housing.

(Outlet parallel to joists.)

(Existing construction)




Mounting brackets mounted to outlet sides of housing. (Outlet perpendicular to joists.)
(New construction)



Mounting brackets flipped over to give approx. I" more clearance.

(Outlet parallel to joists.)

(New construction)



Mounting brackets mounted to top of sides of housing.
(Outlet parallel to joists.)
(New or existing construction)


Mounting brackets flipped over and mounted to top of sides of housing.

(Outlet parallel to joists.)

(New or existing construction)

### **DUCTING OPTIONS**


#### **BLOWER DISCHARGE POSITIONS**

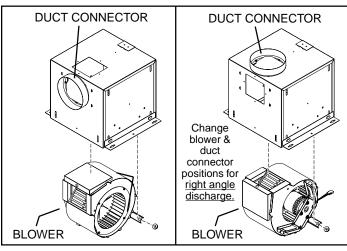

Blower and duct connector in <u>straight through dis-</u> <u>charge</u> position. (Factory shipped)

Blower and duct connector in <u>right angle discharge</u> position.


### DUCTING (Right angle blower discharge)

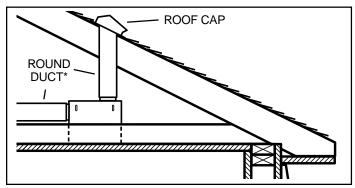

Typical ductwork connection to a ventilator converted to right angle discharge.

\* VCDD010I & VCDD015I use 6" round duct. VCDD020I, VCDD025I & VCDD030I use 8" round duct.

### WIRING OPTIONS

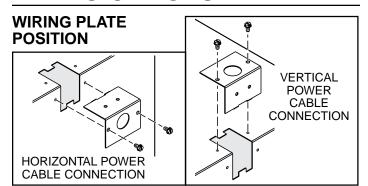

Wiring plate mounts to side or top of housing.

### **USE AND CARE**

Ventilator is designed for continuous operation. If desired, it may be controlled using an on/off switch or an electronic, variable speed control. Follow wiring instructions packed with control, and adhere to all local and state codes, and the National Electrical Code.



WARNING: To reduce the risk of electric shock, disconnect from power supply before servicing.

**To clean blower assembly:** Remove access panel, unplug blower from housing, remove blower mounting nuts, and carefully remove blower from housing. Use appropriate vacuum attachment or a soft cloth and mild soap or detergent to clean blower discharge area and wheel. DO NOT ALLOW WATER TO ENTER MOTOR. Make sure blower assembly is completely dry before reinstalling.

Motor is permanently lubricated. Do not oil or disassemble motor.





Page 4

# **SERVICE PARTS**

		T
KEY NO.	PART NO.	DESCRIPTION
1	97014735	Housing Assembly (VCDD010I & VCDD015I)
	97014736	Housing Assembly (VCDD020I, VCDD025I,
	07044700	& VCDD030I)
2 3	97014728 97014760	Mounting Bracket (2 req.) Damper Assembly (6" dia.)
3	97014760	Damper Assembly (8" dia.)
4	99390098	Duct Connector (6" dia.)
	99390099	Duct Connector (8" dia.)
5	99150415	Screw, 8-18 x 1/4 (12 req.)*
6	98005513	Wire Box Cover
7	99400035	Strain Relief Bushing
8	98005512	Wiring Plate
9	99150471	Ground Screw, 10-32 x ½ (2 req.)
10	97014774 97014775	Scroll Assembly (VCDD010I & VCDD015I)
		Scroll Assembly (VCDD020I, VCDD025I, & VCDD030I)
11	98009399	Inlet Ring
12	99110805	Blower Wheel
13	99080481	Motor (VCDD010I)
	99080482 99080483	Motor (VCDD015I)
	99080484	Motor (VCDD020I)   Motor (VCDD025I)
	99080485	Motor (VCDD030I)
14	99260558	Lock Nut, 8-32 (4 req.)*
15	99250959	Washer (4 req.)*
16	99100491	Grommet (4 req.)
		Blower Assembly, Complete
		(Includes Key Nos. 5 & 10-16)
	97014800	(VCDD010I)
	97014801 97014802	(VCDD015I) (VCDD020I)
	97014802	(VCDD025I)
	97014804	(VCDD030I)
17	99260477	Nut, 1/4-20 (6 req.)*
18	97006039	Wire Harness
19	98009417	Access Panel
20	99420470	Cover Nut (2 req.)
21	99150472	Cover Mounting Screw (2 req.)
22	99150591	Screw, 10-16 x 7/8 (4 req.)*

Order replacement parts by PART NO. - not by KEY NO. \* Standard hardware - may be purchased locally.

# **SERVICE PARTS**

