


Standard Dimensions
(Metric on Reverse Side)

Air Specialties Express, 448 S. Main St., P. O. Box 930040, Verona, WI 53593-0040 Phone: (877)945-9175 Fax: (608)845-6470 www.airspecialties.com

FOR USE WITH MODEL VRBK RESTAURANT EXHAUST FAN

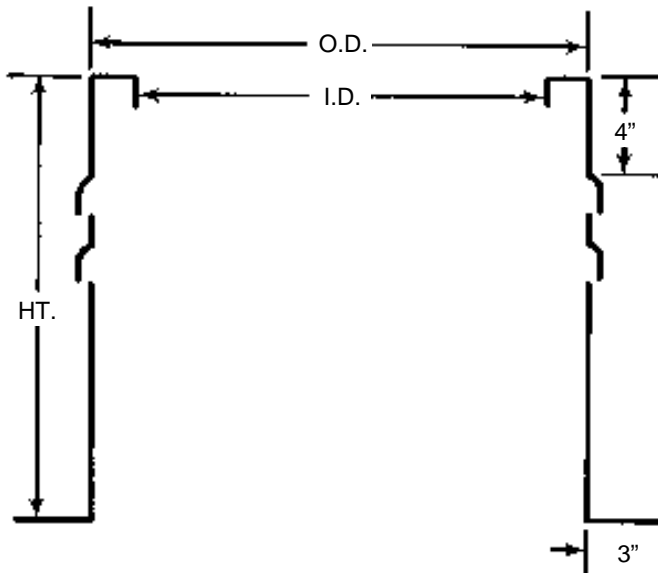

ALL DIMENSIONS LISTED IN INCHES

| VRBK SIZE | CURB CAP ID | CURB O.D. | CURB I.D. | CURB HT.* |
|-----------|-------------|-----------|-----------|-----------|
| 06 | 15-1/2 | 15 | 12 | 26 |
| 08 | 15-1/2 | 15 | 12 | 26 |
| 10 | 17-5/8 | 17 | 14 | 24 |
| 12 | 17-5/8 | 17 | 14 | 24 |
| 15 | 20-1/2 | 20 | 17 | 20 |
| 18 | 25 | 24-1/2 | 21-1/2 | 18 |
| 21 | 28-1/8 | 27-1/2 | 24-1/2 | 18 |
| 24 | 31-1/8 | 30-1/2 | 27-1/2 | 18 |
| 30 | 40-1/8 | 39-1/2 | 36-1/2 | 18 |
| 36 | 46-1/8 | 45-1/2 | 42-1/2 | 18 |
| 42 | 54-1/8 | 53-1/2 | 50-1/2 | 18 |
| 48 | 58-1/8 | 57-1/2 | 54-1/2 | 18 |

STANDARD CONSTRUCTION

- Continuously welded 18 gauge galvanized steel
- Neoprene gasketing (For Field Installation)
- 5" wide by 1" high louvered slots, 4 per side, on all sides
- No insulation; no wood nailer
- Aluminum construction optional

*Curb height selected to allow 18" welded duct height and maintain 40" discharge height required per NFPA 96.

CURB SIZE DESIGNATION

First 3 digits "A" Dimension in inches, 4th digit number of eights in fraction (1/2" is 4 eights). Size 24-1/2" x 36" would be SIZE: **0244 0360**.

| LOCATION/MARK | QUANTITY | MODEL | SIZE | HEIGHT | OPTION |
|---------------|----------|-------|------|--------|--------|
| | | | | | |
| | | | | | |
| | | | | | |
| | | | | | |
| | | | | | |

NOTES

PROJECT:

ARCHITECT:

CONTRACTOR:

DATE:


SUBMITTED BY:

ENGINEER:

Metric Dimensions
(Standard on Reverse Side)

Air Specialties Express, 448 S. Main St., P. O. Box 930040, Verona, WI 53593-0040 Phone: (877)945-9175 Fax: (608)845-6470 www.airspecialties.com

FOR USE WITH MODEL VRBK RESTAURANT EXHAUST FAN

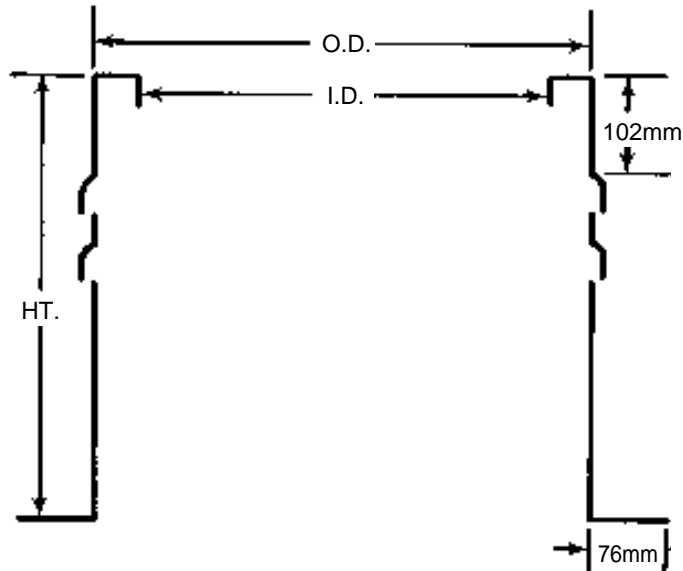

ALL DIMENSIONS LISTED IN MILLIMETERS

| VRBK SIZE | CURB CAP ID | CURB O.D. | CURB I.D. | CURB HT.* |
|-----------|-------------|-----------|-----------|-----------|
| 06 | 394 | 381 | 305 | 660 |
| 08 | 394 | 381 | 305 | 660 |
| 10 | 448 | 432 | 356 | 610 |
| 12 | 448 | 432 | 356 | 610 |
| 15 | 521 | 508 | 432 | 508 |
| 18 | 635 | 622 | 546 | 457 |
| 21 | 714 | 699 | 622 | 457 |
| 24 | 791 | 775 | 699 | 457 |
| 30 | 1019 | 1003 | 927 | 457 |
| 36 | 1172 | 1156 | 1080 | 457 |
| 42 | 1375 | 1359 | 1283 | 457 |
| 48 | 1476 | 1461 | 1384 | 457 |

STANDARD CONSTRUCTION

- Continuously welded 18 gauge galvanized steel
- Neoprene gasketing (For Field Installation)
- 127mm wide by 25mm high louvered slots, 4 per side, on all sides
- No insulation; no wood nailer
- Aluminum construction optional

*Curb height selected to allow 18" welded duct height and maintain 40" discharge height required per NFPA 96.

| LOCATION/MARK | QUANTITY | MODEL | SIZE | HEIGHT | OPTION |
|---------------|----------|-------|------|--------|--------|
| | | | | | |
| | | | | | |
| | | | | | |
| | | | | | |
| | | | | | |

NOTES

| | | | | | |
|-------------|--|-------|---------------|--|-----------|
| PROJECT: | | | ARCHITECT: | | |
| CONTRACTOR: | | DATE: | SUBMITTED BY: | | ENGINEER: |

Page _____ of _____